




Technoform Bautec Kunststoffprodukte GmbH Service Center Akkreditierte Prüfungen	Ostring 4 34277 Fuldabrück Germany	Tel.: +49 (0)561 9583 420 Fax: +49 (0)561 9583 589 Email:service-center@technoform.de
---	--	---

Determination of heat transition coefficient with the controlled hotbox method
Reference standard EN 12412-2 (07-2003)

Test report	SCAP 2011-002-1	Date:	18.10.2011
--------------------	------------------------	-------	------------

Client	Address
ETEM Bulgaria SA	119A Ilientzi blvd. 1220 Sofia Bulgaria

Specimen description	
System name: E99 Vertical Section	
Manufacturer: ETEM Bulgaria SA	
Manufacturing date:	11.08.2011
Serial number:	-
Sampling (with date):	12.08.2011
Reception date:	30.08.2011
Profile category: Unitized façade system	

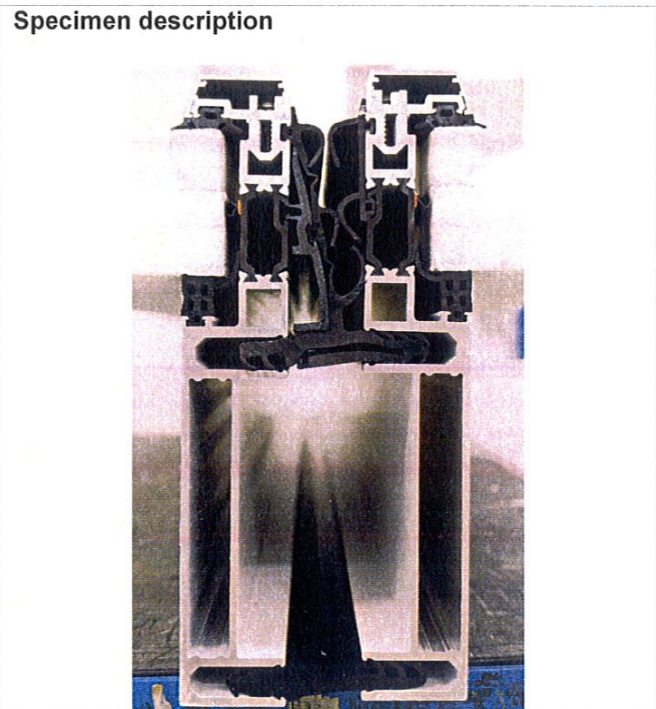

Specimen height:	1479 mm	Specimen amount:	6
Specimen width:	99 mm	b/B-Ratio	0,331
Specimen depth:	222 mm	Thickness of filling:	30 mm

Test result			
U_f =	2,41 W/m²K	ΔU_f (Uncertainty)	0,072 W/m²K

Remark: The result is related only to the tested specimen. The test report shall not be reproduced except in full, without written approval of the laboratory.

Tester Sebastian Reschel	Deputy Lab Manager Ferdinand Bebbler
Name / Signature	Name / Signature